


STANDARD 1" SERVICE

NO PLASTIC SERVICE LINES ALLOWED, SERVICE LINES SHALL BE DUCTILE IRON OR K COPPER

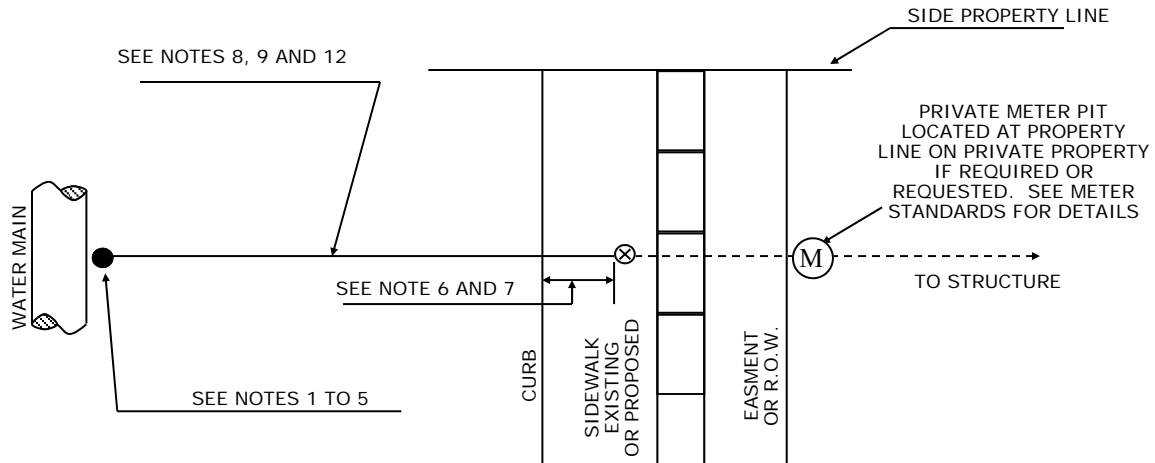

NOTES:

1. TAP SHALL NOT BE LOCATED WITHIN 36" FROM A BELL OR FLANGE CONNECTION.
2. TAP SHALL NOT BE LOCATED WITHIN 36" FROM ANOTHER TAP UNLESS APPROVED BY THE COUNCIL BLUFFS WATER WORKS.
3. PERMIT APPLICANT TO REPAIR ANY DAMAGE TO POLYETHYLENE ENCASEMENT INCURRED WHILE EXPOSING MAIN FOR TAP.
4. ALL COPPER SERVICES SHALL HAVE A MINIMUM OF 3' OF POLYETHYLENE ENCASEMENT ON SERVICE EXTENDING FROM MAIN, INSTALLED BY THE CONTRACTOR.
5. COUNCIL BLUFFS WATER WORKS TO SUPPLY AND INSTALL CORPORATION STOP.
6. CONTRACTOR TO INSTALL CURB STOP AND BOX. CURB STOP AND BOX SUPPLIED BY THE COUNCIL BLUFFS WATER WORKS.
7. CURB STOP SHALL BE LOCATED IN RIGHT OF WAY A MINIMUM OF 3' FROM THE BACK OF CURB BETWEEN THE CURB AND SIDEWALK. CURB STOP SHALL NOT BE LOCATED IN A SIDEWALK OR DRIVEWAY UNLESS APPROVED BY THE COUNCIL BLUFFS WATER WORKS.
8. ALL SERVICE LINE MATERIAL SHALL BE TYPE K COPPER. NO PLASTIC SERVICES LINES ALLOWED.
9. THE SERVICE LINE LAID BETWEEN THE CORPORATION STOP AND THE CURB STOP SHALL BE ONE CONTINOUS PIECE
10. THE SERVICE LINE BETWEEN THE CURB STOP AND BUILDING SHALL HAVE MINIMUM 100' BETWEEN JOINTS.
11. OWNERSHIP, THE COUNCIL BLUFFS WATER WORKS WILL NOT BE RESPONSIBLE IN ANY WAY FOR THE WATER SERVICE LINE BEGINNING AT THE CONNECTION TO THE MASTER STOP ON THE CUSTOMERS SIDE OF THE SERVICE.
12. ANY PART OF THE SERVICE PLACED BETWEEN THE MAIN AND MASTER CURB STOP SHALL BE INSPECETED BY THE COUNCIL BLUFFS WATER WORKS BEFORE IT IS COVERED UP.
13. CONTACT THE COUNCIL BLUFFS BUILDING DIVISION, FOR ADDITIONAL PLUMBING CODE REQUIREMENTS AND COUNCIL BLUFFS FIRE DEPARTMENT FOR ADDITIONAL FIRE SERVICE CODE REQUIREMENTS.

STANDARD 1" SERVICE INSTALLATION FOR WATER SERVICE

COUNCIL BLUFFS WATER WORKS



SCALE: NONE

DATE: 11/1/2017

FILE NAME: 1TYPICAL SERVICE INSTALL 2017