



WATER TREATMENT PROCESS

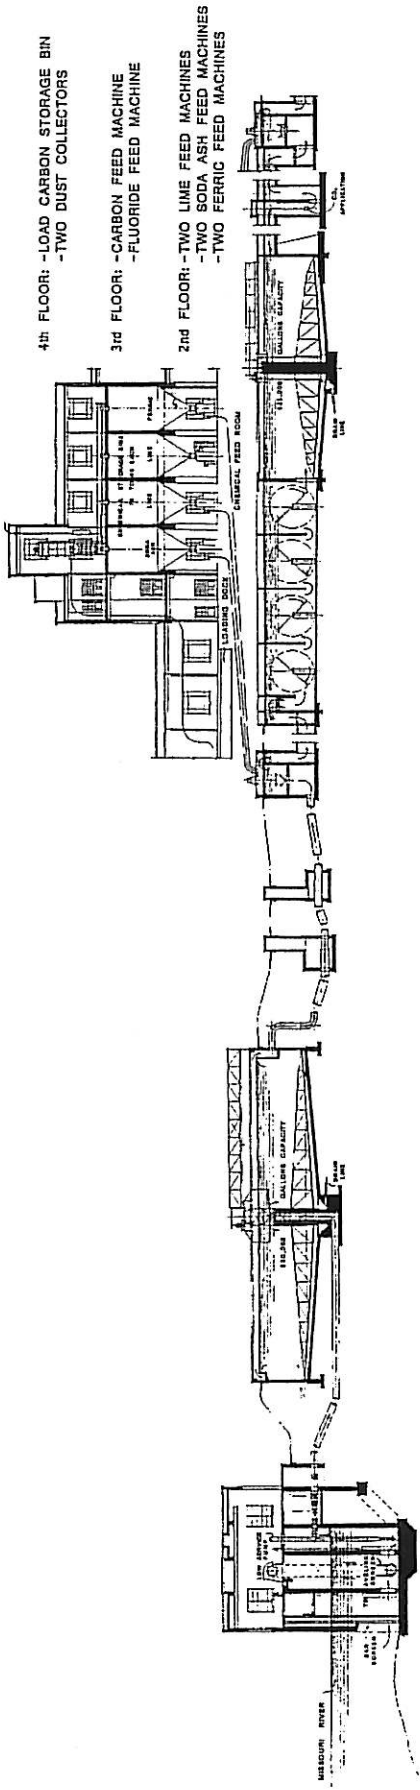

INTAKE STRUCTURE PRELIMINARY SETTLING BASIN SETTLED WATER LINE VALVE VAULT FLOW METER LIFT MIXER FIRST STAGE FLOCCULATION BASIN FIRST STAGE CLARIFIER BASIN CO₂ CHAMBER LIFT MIXER

HIGH SERVICE PUMPS:
 #1) 300 HP MOTOR
 #2) 500 HP MOTOR
 #3) 500 HP MOTOR
 #4) 350 HP MOTOR

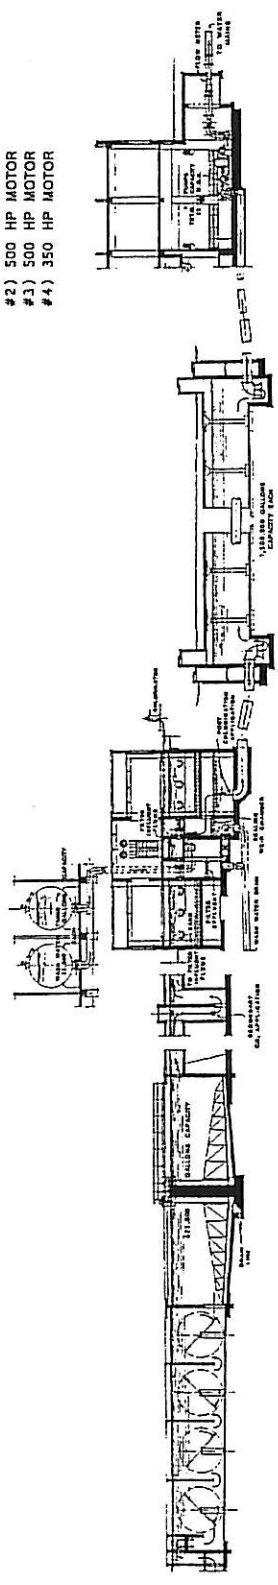

SECOND STAGE FLOCCULATION BASIN SECOND STAGE CLARIFIER BASIN SECONDARY CO₂ CHAMBER FILTERS #1 — CLEARWELLS — #2 HIGH SERVICE PUMP ROOM